



RECOMMENDED PIPE SIZES IN ORDER TO SUPPLY WATER FIXTURES.

SILL FAUCET (HOSE)	3/4"
SINK	1/2"
LAVATORY	1/2"
LAUNDRY TRAY	1/2"
HOT WATER TANK	3/4"
BATH TUB	1/2"
SHOWER BATH	1/2"
SHOWER BATH - NEEDLE TYPE	3/4"
WATER CLOSET - TANK TYPE	1/2"
WATER CLOSET - FLUSHOMETER	1"
URINAL - TANK TYPE	1/2"
URINAL - FLUSHOMETER TYPE	3/4"

RISER OR RUNS SERVING 2 FIXTURES	3/4"
RISERS OR RUNS SERVING 3 OR MORE FIXTURES	1"
RISERS OR RUNS SERVING FLUSHOMETER VALVE	1"
BASEMENT SUPPLY LINE	1"
TYPE "K" HOUSE LINE (MINIMUM)	1"

NOTE: LARGE RESIDENTIAL HOMES MAY REQUIRE WATER CALCULATIONS AS DIRECTED BY THE CITY OF STOW ENGINEERING DEPT.

NOTE: THE ENTIRE SERVICE SHALL BE BED IN 4" SAND AND BACKFILLED 12" ABOVE TOP OF THE SERVICE LINE FROM THE WATER MAIN TO THE UTILITY EASEMENT LINE.

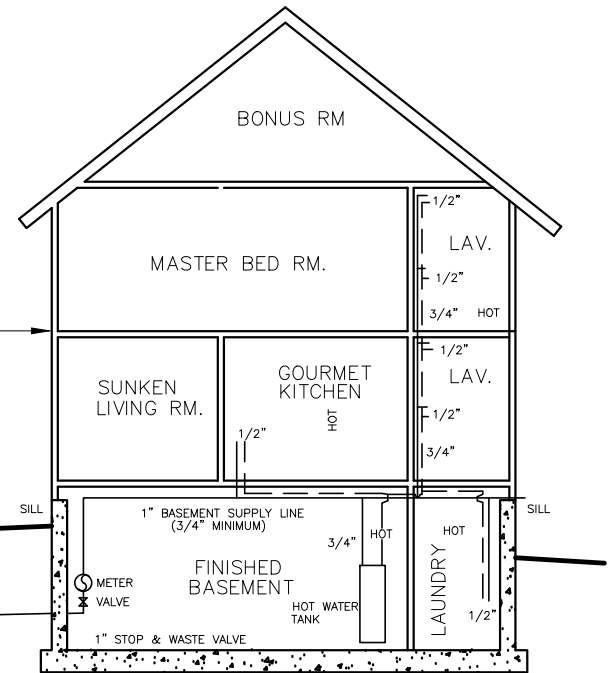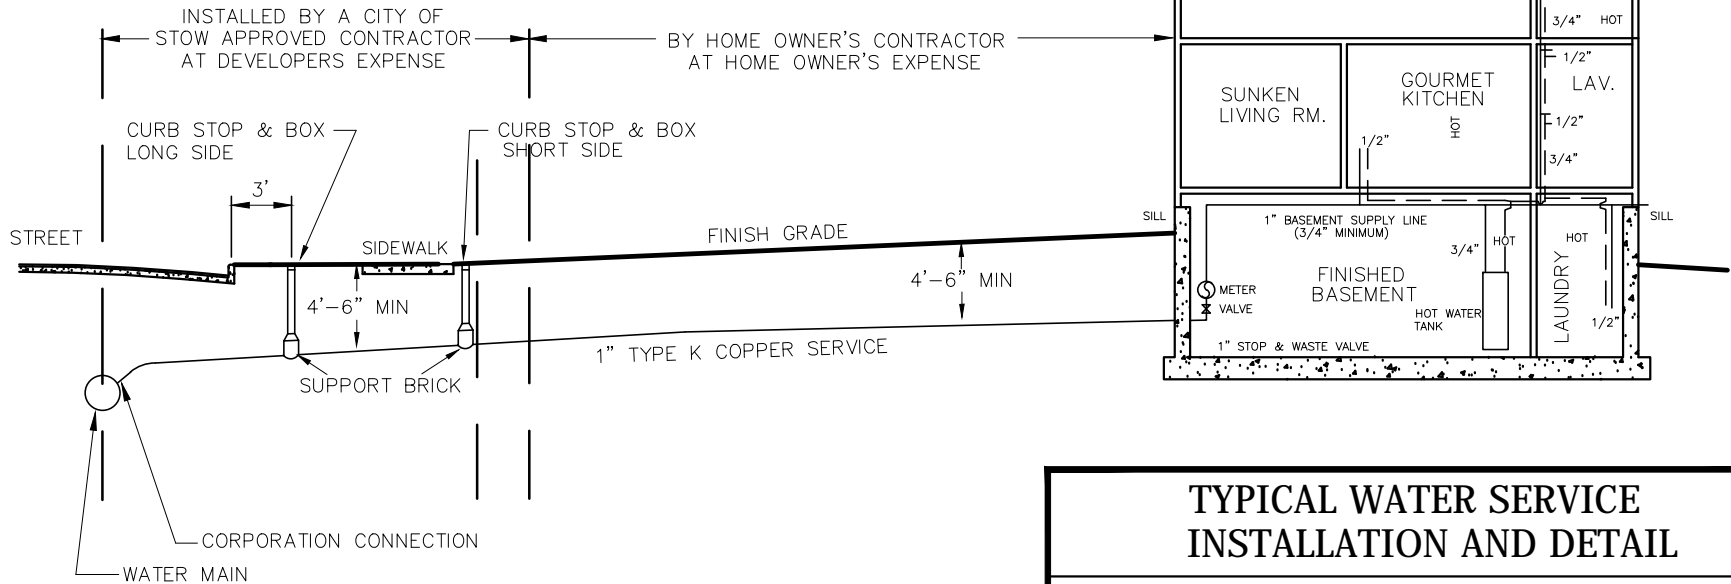

**TYPICAL WATER SERVICE
INSTALLATION AND DETAIL**

CITY OF STOW WATER DEPARTMENT

DRAWN BY: TJS

DATE: MAY, 2002

REVISED:

DRAWING NAME: SDW-3.DWG

APPROVED BY:

J. Wallin Orew

MAY, 2002